



END ELEVATION

0 1 2 3 4 FT.

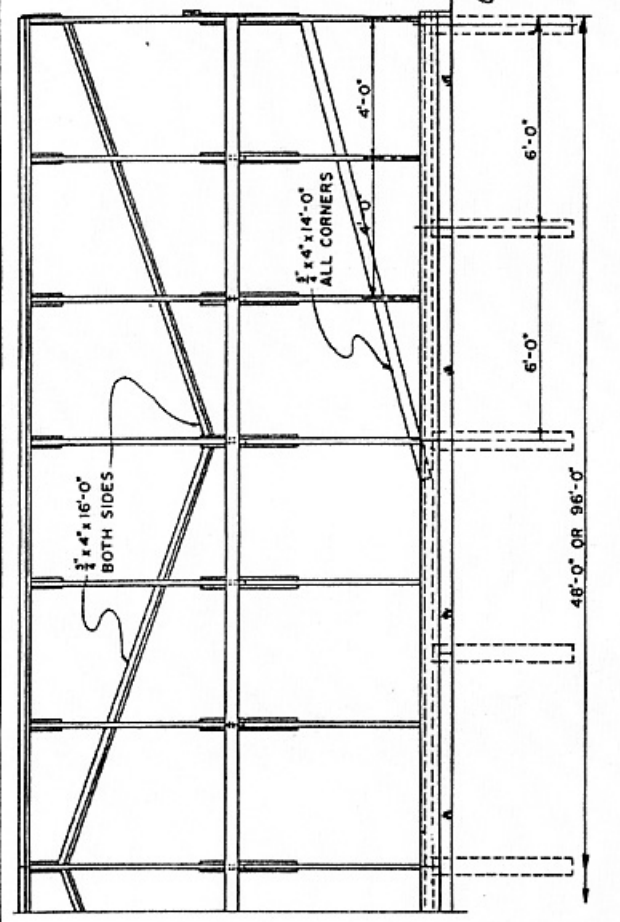

SIDE ELEVATION


0 1 2 3 4 FT.

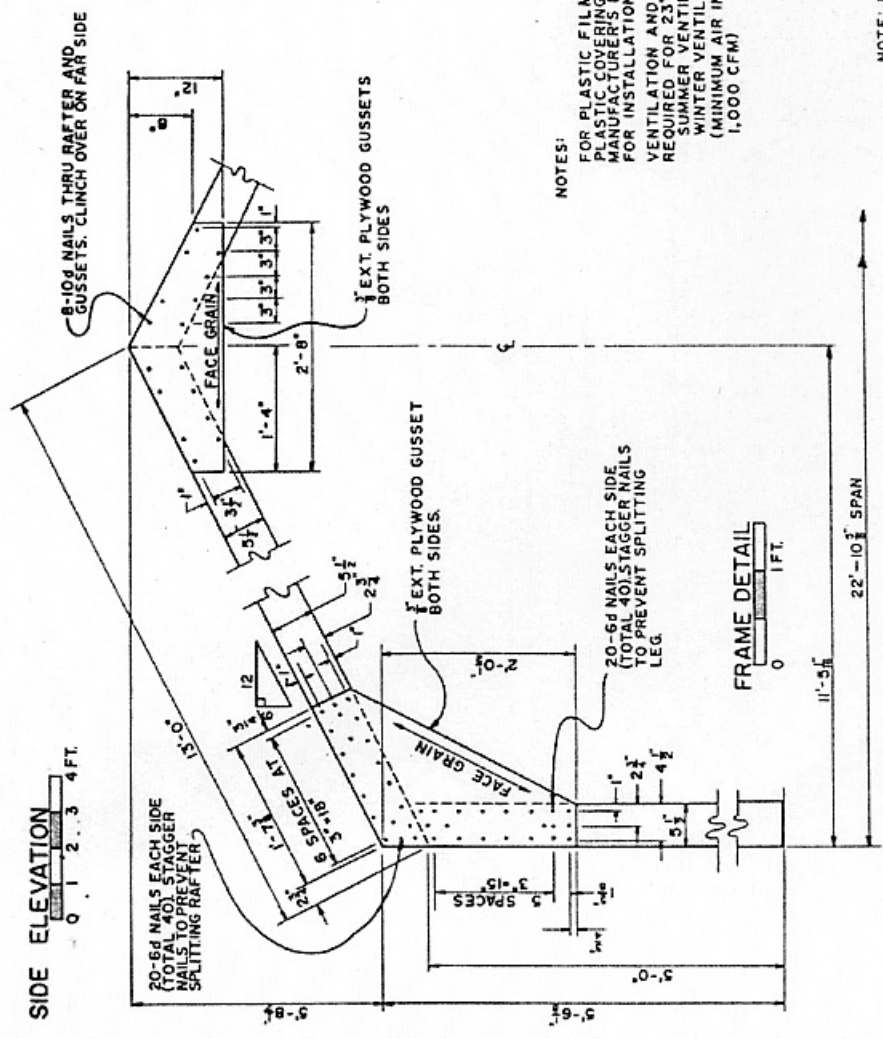

NOTES:
 FOR PLASTIC FILM AND RIGID
 PLASTIC COVERING FOLLOW
 MANUFACTURER'S DIRECTIONS
 FOR INSTALLATION.
 VENTILATION AND HEATING:
 REQUIRED FOR 23 X 48 HOUSE:
 SUMMER VENTILATION - 10,000 CFM
 WINTER VENTILATION - 660 CFM
 (MINIMUM AIR INTAKE - ONE SQ. FT. PER
 1,000 CFM)

FRAME DETAIL

0 1 FT.

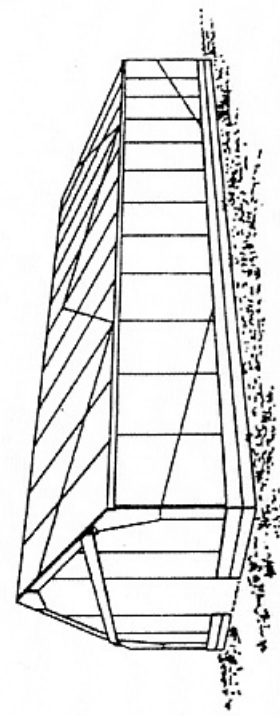

PERSPECTIVE

